

ELSYS Corp.

**Polygraph evolution
in Russian Federation**

Minkin Viktor
Medvedev Andrey


Polygraph evolution in Russian Federation

PRIVATE

Jurisprudence

Asset 64 Labour Code (workers's qualities)

Assets 85-90 (privacy)

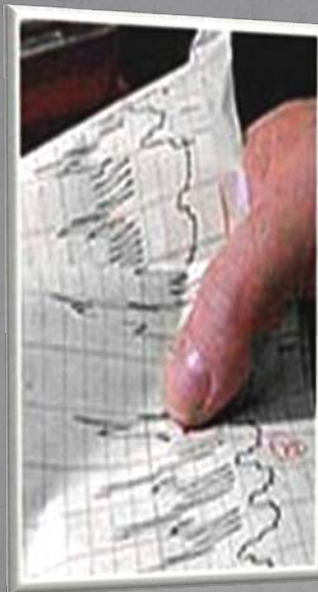

History of polygraph detector in Russia

1923-27 A.R.Luria's experiments on
phygmograph, direct method

1975 KGB lab in USSR

Firstly applied motor
function method for
suspected person



Varlamov V.A

Polygraph
developer
Krasnodar
polygraph
trend founder



Polygraph
developer
One of Moscow
polygraph trend
founders

Soshnikov A.P.



Komissarova J.V.

Author of viewing
polygraph
method/. First
court expertise
with polygraph



Evolution of hardware


12.08.1995 Law “about operative-research activity” #144 FL

Departments which use polygraph detector

“KRS”	“EPOS”	“Diana”	“Concordia”
Comp	Comp	Comp	Comp
Have own syllabuses for polygraphist + “Antaeus”			
There are about 30 polygraphists in Russia			

other	MVD	FSB	Narco police	Custom house	UFIN	Office of Public Prosecutor
People are instructed						
500	1000	100	50	50	100	100
Really in work						
100	200	50	50	50	50	80

Differences of polygraphs produced in Russia

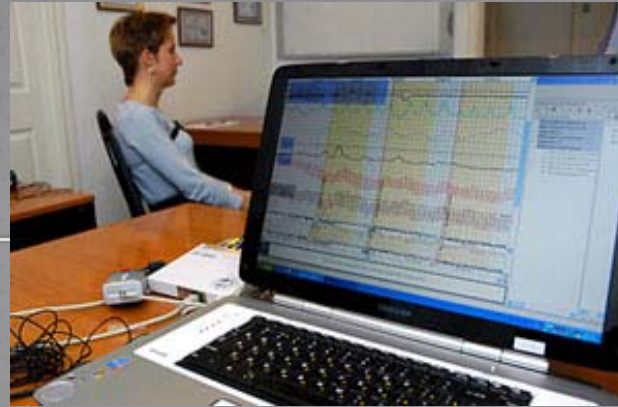

model	AD	Extra	Tremor	Better works	assemblage	upgrade
Diana	build in	Video+text	+pad	Direct	sure	+
Epos	outside	-		Direct	unsure	+
Concordia	out	Video+text +voice	+pad	Direct	unsure	+
Kris	-	-	+pad	Indirect	unsure	+

Polygraph assisted Investigations

Investigation in operative units:

- clearance of crime
- administrative review.

- Criminal investigation
- Civil investigation
- Administrative investigation

Investigation on different enterprises

Using of instrumental lie-detection as an acceptable proof for court

Polygraph

Calligraph

Vibrainage



Operation of Vibraimage + polygraph

Current task for this equipment

1. Increase of validity for every single test
2. Increase of validity with different tests results
3. Elimination of PDD examiner's errors
4. Elimination of examinee's resistance



Pretest interview

Basic steps

1	Tuning with verbal and non-verbal signs
2	Asking of examinee to state his own version of happen. Ask some question for better Vibraimage's operation.
3	Voice questionnaire (dialogue) so that examinee mostly expressed his emotions.
4	Adjust questionnaire if necessary


Interferences

1	Wrong shooting
2	Noises (glasses, cream on face, slurred diction, botox)
3	Sound noises (phone, pager, other sound equipment)
4	Indisposition (lack of sleep, different problems which subject is thinking of)

Complicated cases

Person is not emotional


N	Feature	The tested version	Recommendations
1	Monotonic answers	Testing of character accentuation on psychopathy	1. Prof. Filonov's stimulating questions 2. Questions with use of Mian-xian physiognomy
2	Eyes are immobile		
3	Answers are short		
4	Mimicry is poor		

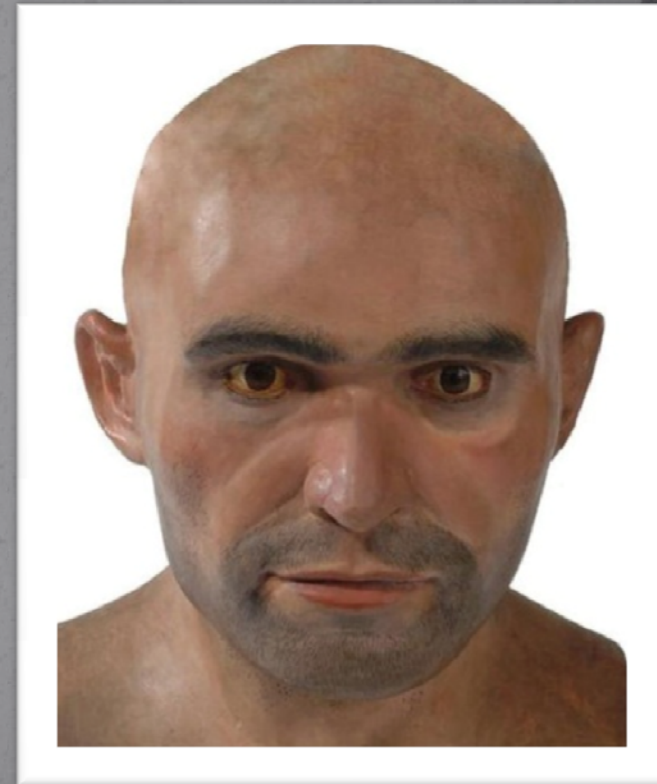

Maximum benefits of pretest interview

- 1 Lack of sensors on the test, preventing the normal dialogue and gestures.
- 2 Highest emotional stress, the absence of fatigue from the tests.
- 3 Opportunity to express their ideas in a familiar form without test distortion
- 4 Ability to understand which of the polygraph issues caused misunderstanding the question and should be adjusted.

The degree of individual zones tension gives a hint of readiness for testing

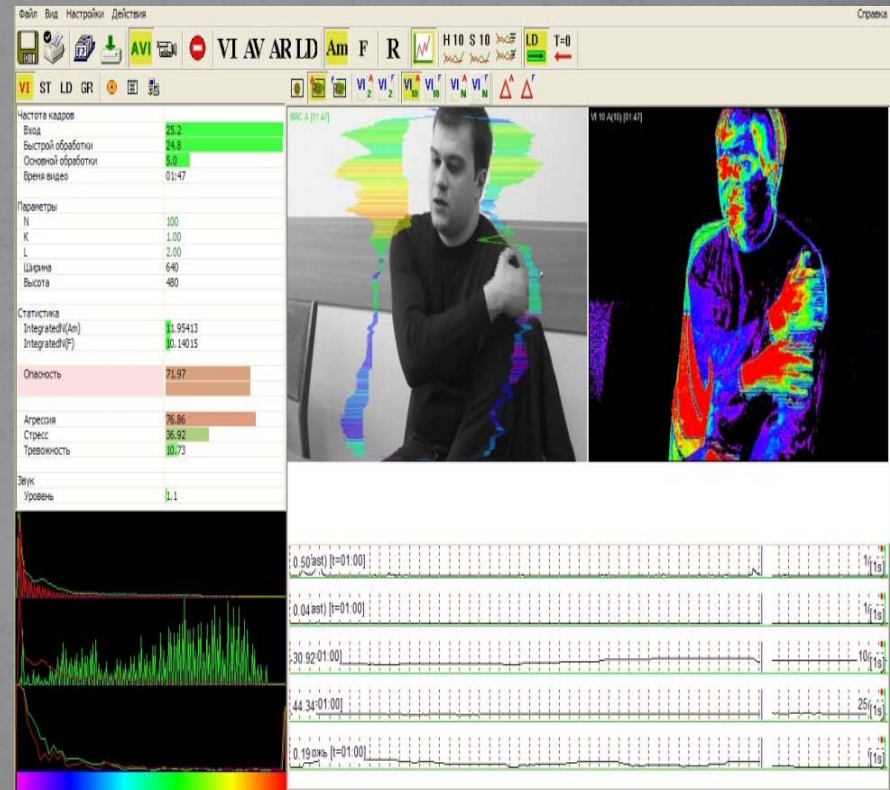


Pretest interview

Operation with visual Vibraimage marks

Marks for attention at first


1	The appearance of green in the aura divided with yellow and red
2	Asymmetry of the aura of the left and right sides.
3	Asymmetry of muscle tension in the face and chest.
4	The appearance of the tension triangle (area lip, nose, eye area)
5	Changing dynamics in the form (seal or extension) of the aura and its color after the question of polygraphist.

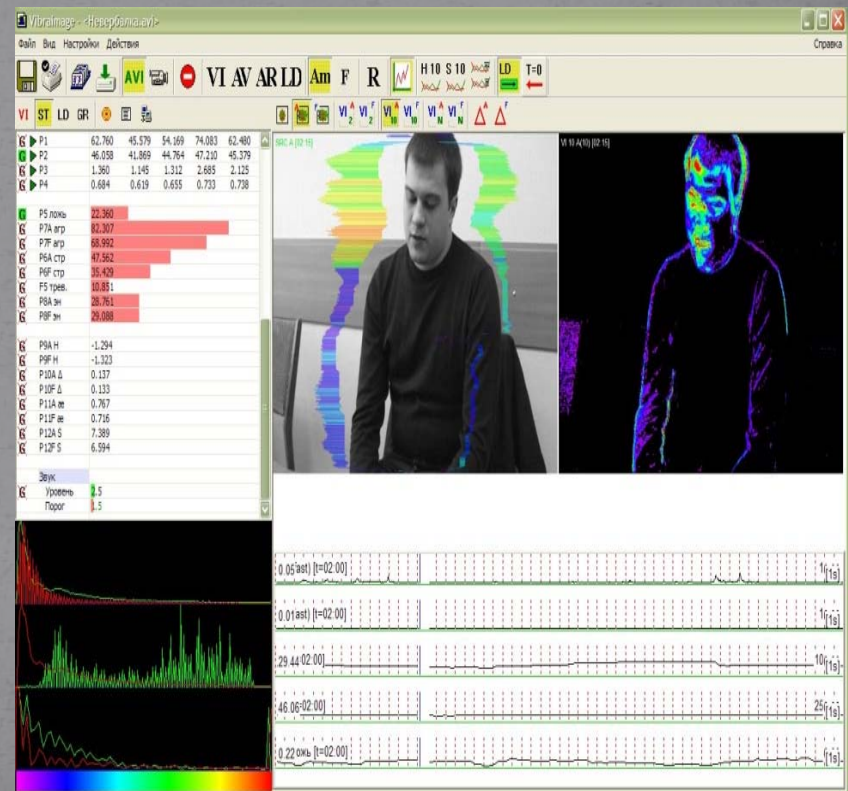

Scoring procedure of questionnaire

PDD examiner deals with questionnaire and recording “live video” with post-test analysis.

1	Backster test, st. Utah
	N- (Outside issue)*- (Sacrifice)*-(C-C-C...)- (R-R-R).
2	D. Likken test
	Score only Preparatory
3	Test of control and neutral questions
	(N-N-N) -(C)- (R-R-R)

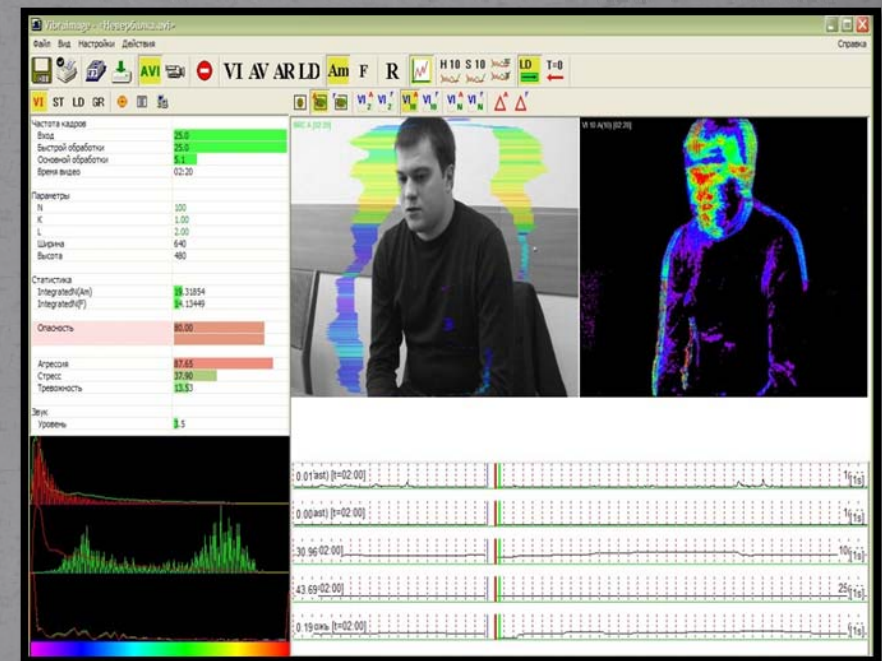

*Outside issue – may be not pronounced

Documents for forensic examination with polygraph

Diploma of University




Certificate of Compliance




Vibrainage - video polygraph

Steps Before PDD examination by vibrainage:


1. Select a correct position of person

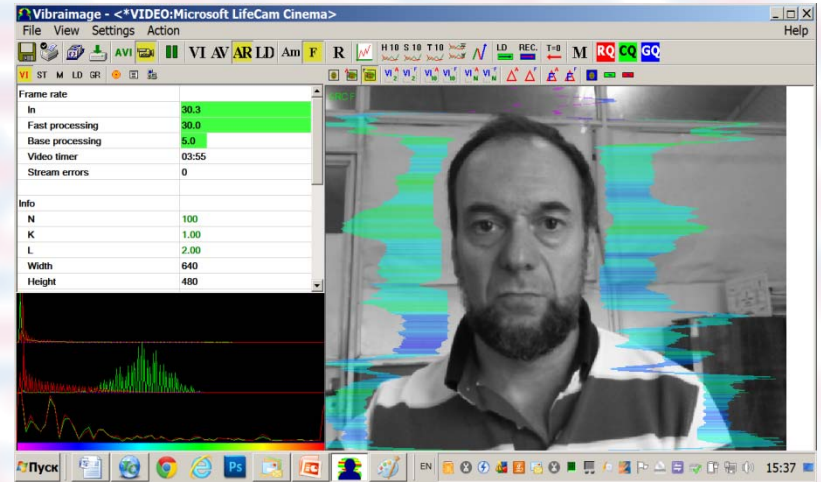

Low quality – up is cut

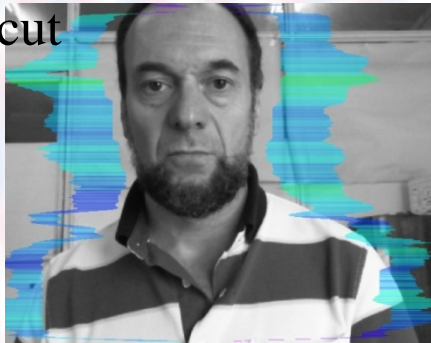

Low quality – side is cut

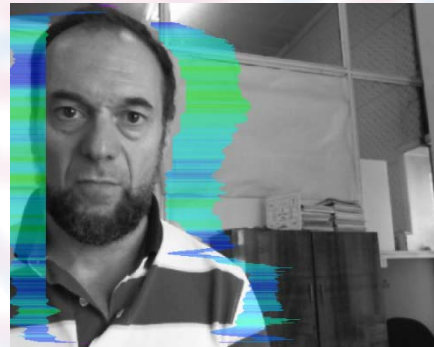

Low quality – face is small




The person image must be high quality, the maximal facial size on screen is preferable and face position must be in the center of the screen. For the frame with horizontal resolution 640 pixels the person face should be not less than 200 pixels.

Vibraimage - video polygraph

Before PDD examination start by vibraimage:

2. Stand a correct system settings

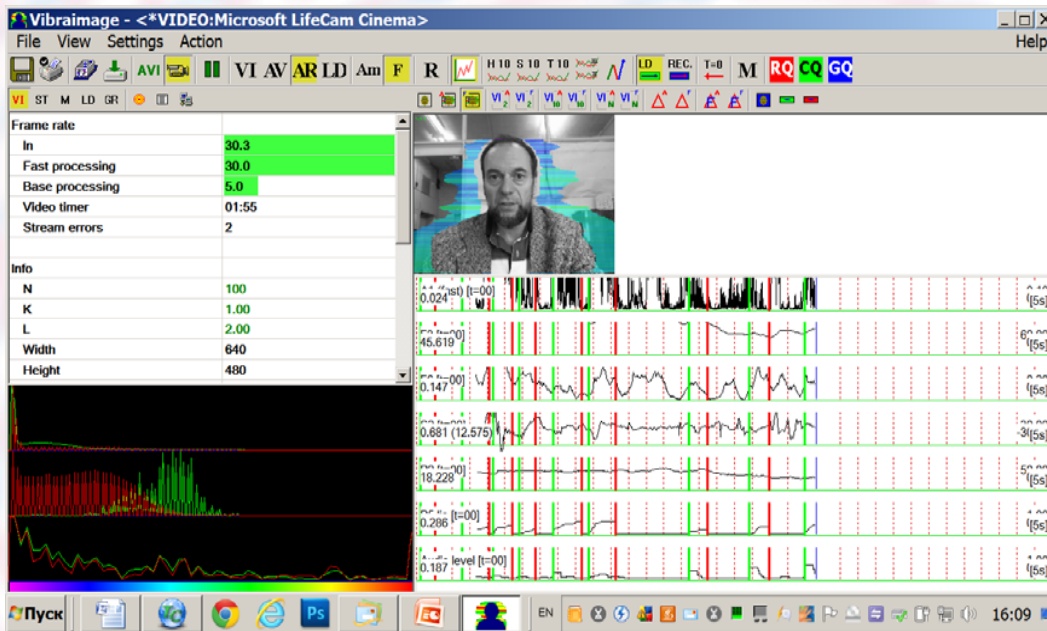

The screenshot shows the settings window of the Vibraimage software. It contains a list of configuration options with their current values. A red arrow points to the 'LD default' setting, which is set to 'Set'.




VI	ST	M	LD	GR		
Critical level %						60.00
Auto capture image (s)						0
Show N image						0
Sound (Susp.)						No
Sound (A)						0 %
Sound (S)						0 %
Sound (T)						0 %
marker's beep						No
reset beep						No
X1						
X2						
X3						
X4						
X5						
Vibra-sound						
disable std. sound						No
no sound						Yes
CG						
CR						
HG						
HR						
SG						
SR						
VI Device						No
Indication						No
Micro default						Set
Macro default						Set
LD default						Set

Start from LD default settings and control Video IN rate, Base processing rate, Stream errors and processor power

Vibrimage - video polygraph

Before PDD examination start by vibrimage:


3. Stand correct system audio settings

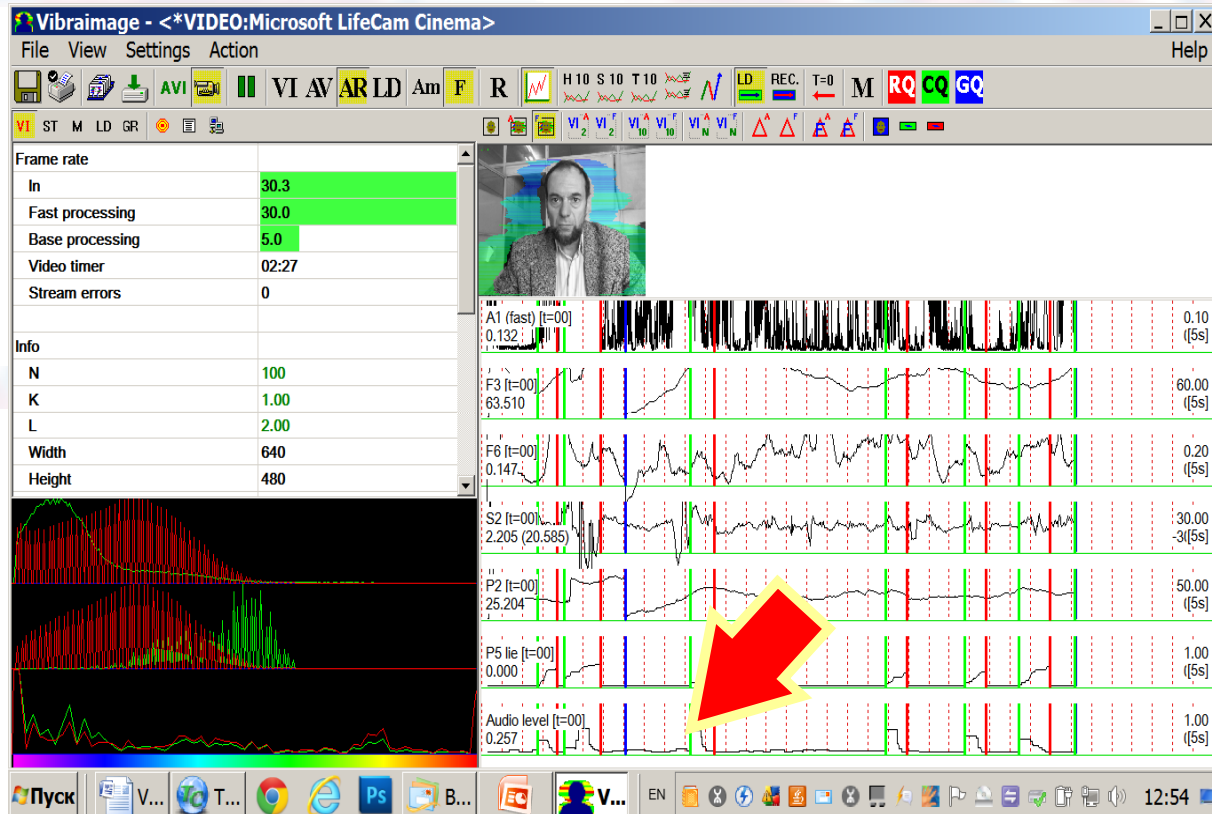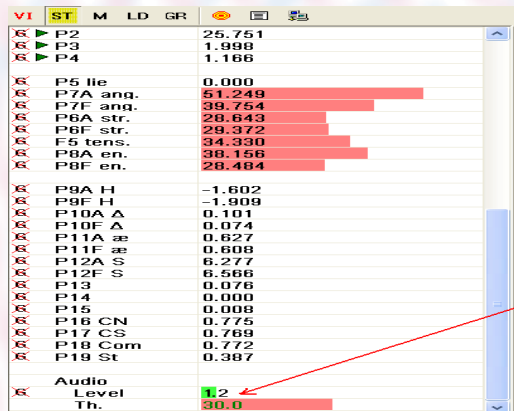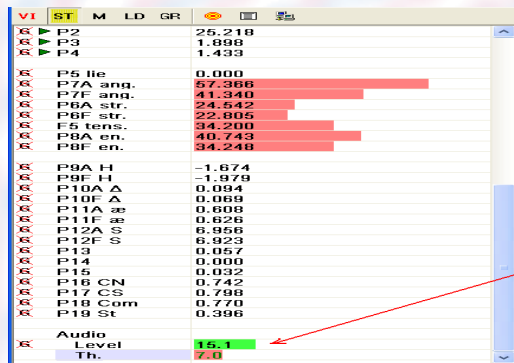

After standing Audio Threshold you need to test audio quality on the down graph of LD default menu. With the question start you need to see green vertical line and red line after some seconds of the reply

Vibrimage - video polygraph


Vibrimage parameters rates and PDD calculations

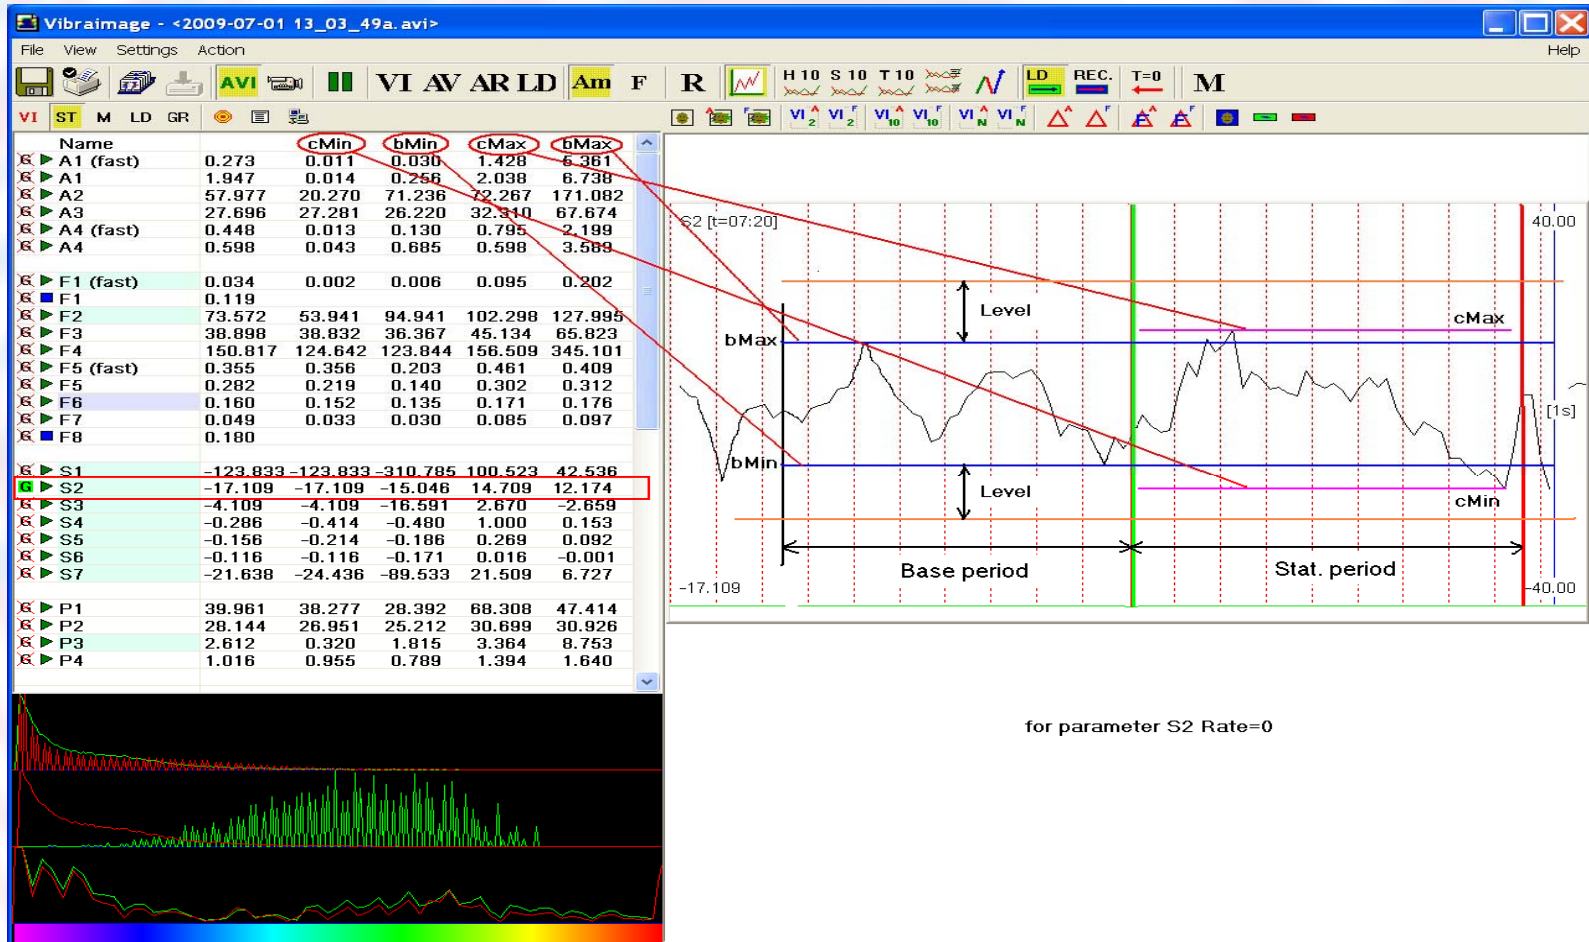

No difference between Stat period and Base period for indicated parameter S2

Vibrimage - video polygraph


Vibrimage parameters rates and PDD calculations

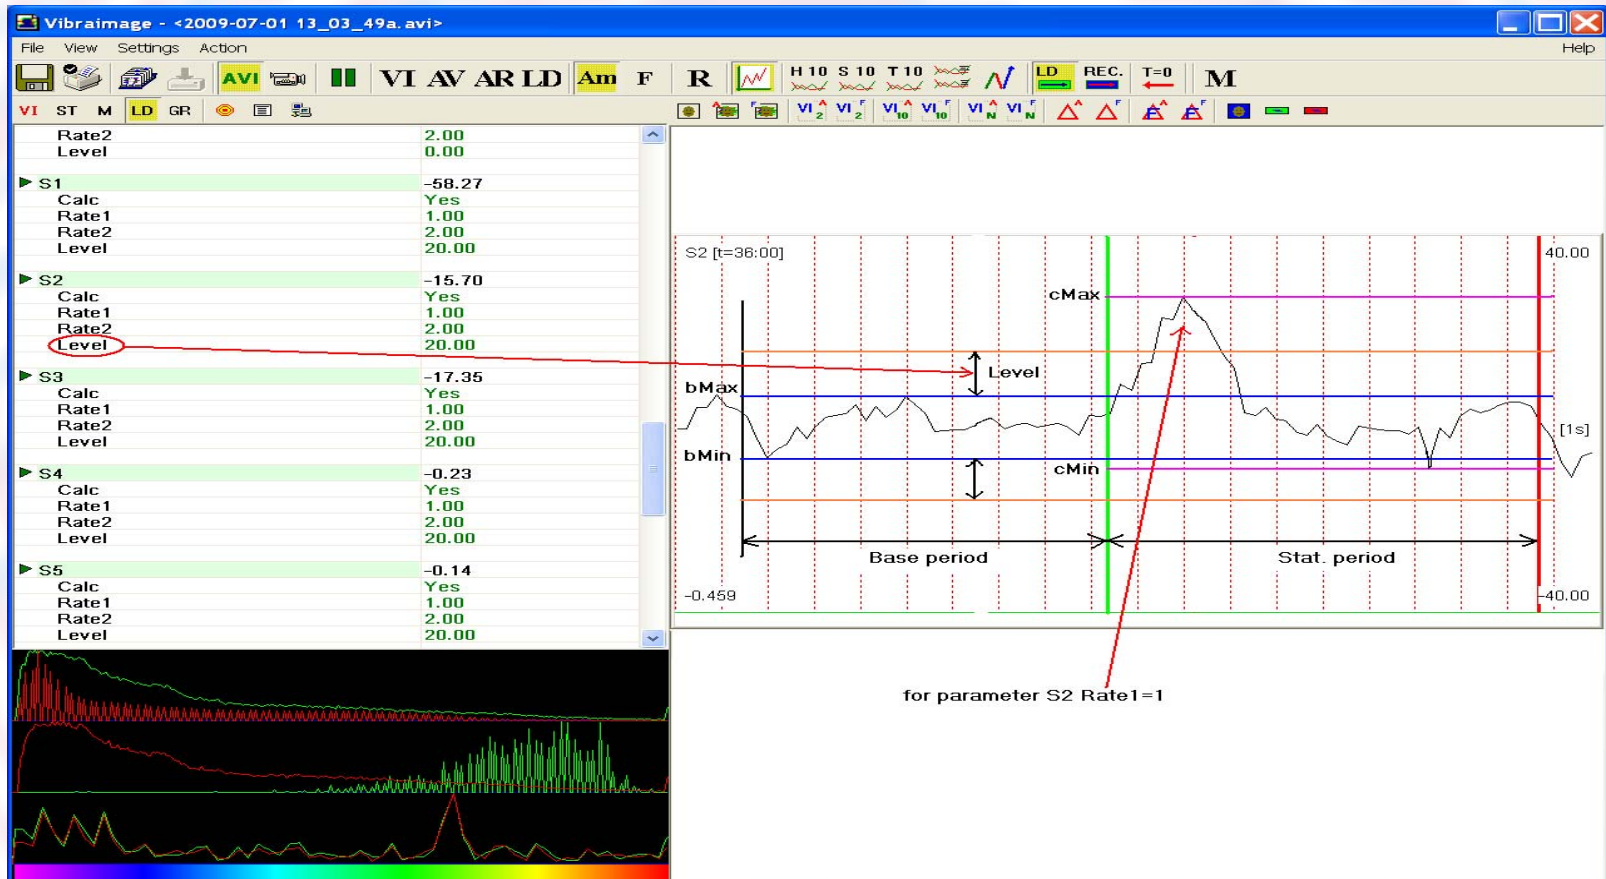

Significant changes of the one level of parameter between Stat period and Base period for indicated parameter S2

Vibrimage - video polygraph

Vibrimage parameters rates and PDD calculations

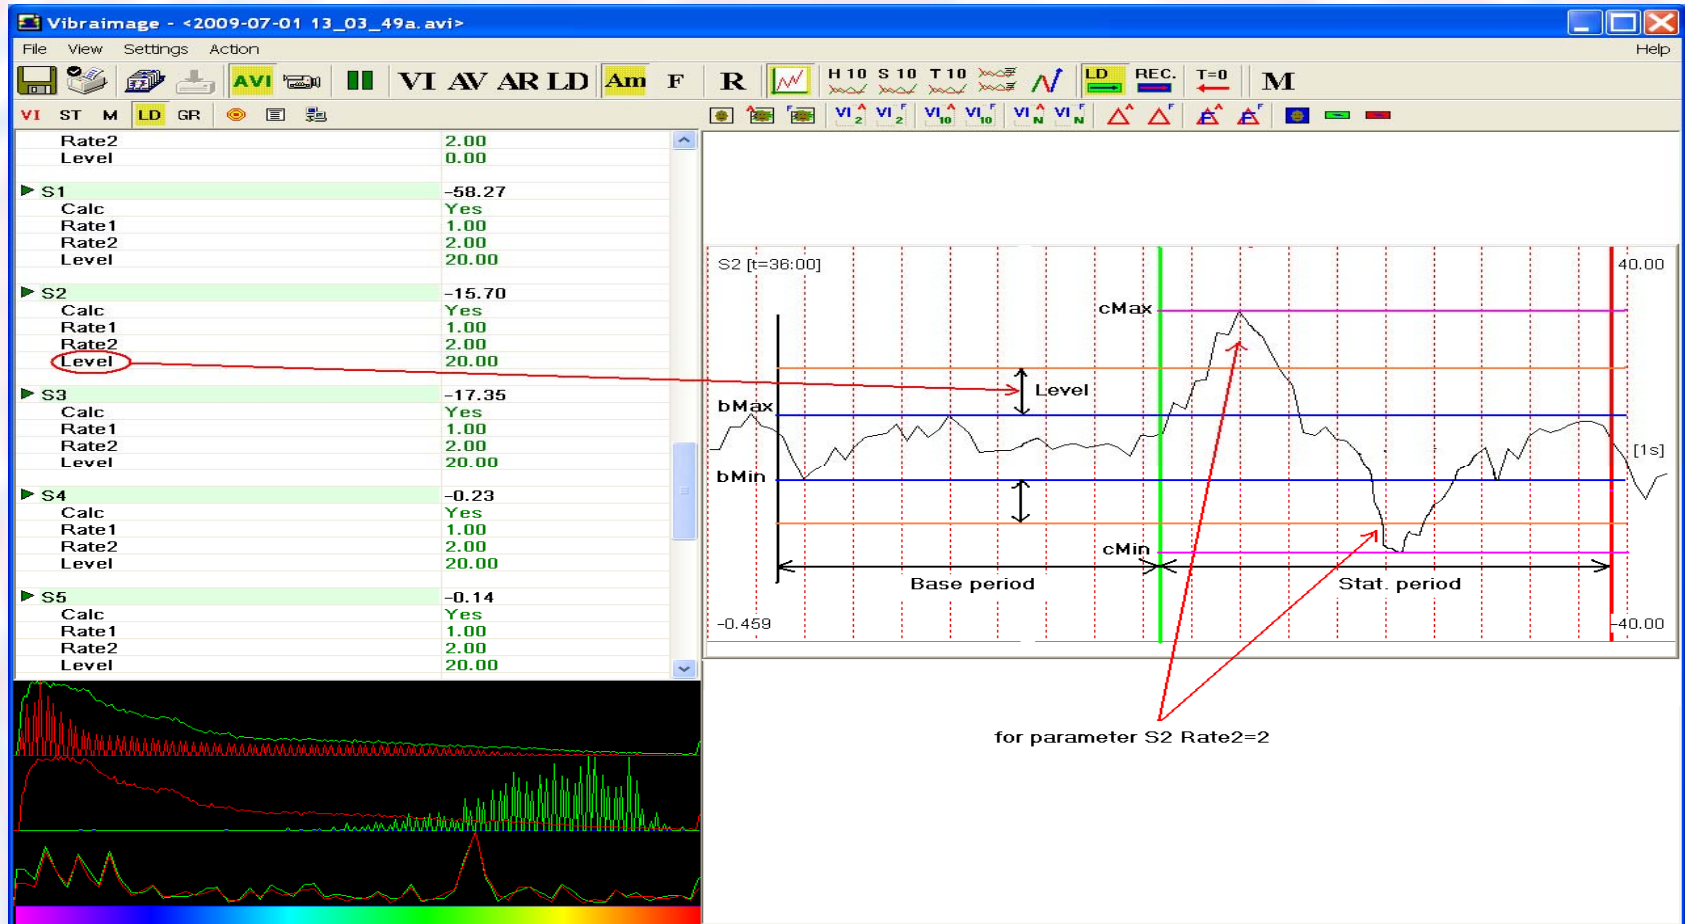

Significant changes of the two levels of parameter between Stat period and Base period for indicated parameter S2

Vibraimage - video polygraph

Vibraimage PDD equation

$$L = \frac{\sum_{i=1}^m P_i * K}{\sum_{c=1}^n P_c * K}$$

P_i – parameter with significant changes between Base period and Stat period;

P_c – parameter measured for lie detection;

K – rate coefficient for measured parameter P_i .

n – number of measured parameters for lie detection;

m – number of changed parameters during lie detection

P5 and P20 difference


P5 - equal rates (1,2) for every parameter – interview testing

P20 – individual rate for every parameter – Comparative testing (Backster, MCT)

A4 (fast)	0.00
Calc	Yes
Rate1 V	1.00
Rate2 V	2.00
Rate1 C	-1.00
Rate2 C	0.00
Level	100.00
A4	0.00
Calc	Yes
Rate1 V	1.00
Rate2 V	2.00
Rate1 C	1.00

Vibrimage - video polygraph

Auto processing of Vibrimage PDD results file recording

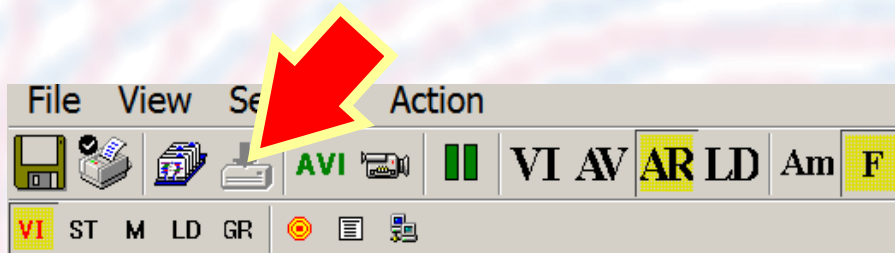

max result

RQ(m)	-13,00	3		
RQ(m) stat:	-6,00	-3,00	-4,00	
CQ(m)	1,00	3		
CQ(m) stat:	1,00	0,00	0,00	
LD(M)	NDI			

global result

LD result NDI

average result

RQ(a)	32,14	3		
RQ(a) stat:	39,29	30,36	26,79	
CQ(a)	33,33	3		
CQ(a) stat:	39,29	26,79	33,93	
LD(a)	INC			

integrated result

RQ(i)	187,12	3		
RQ(i) stat:	189,84	171,70	199,84	
CQ(i)	243,53	3		
CQ(i) stat:	337,87	156,91	235,81	
LD(i)	NDI			

Vibrainage - video polygraph


Question response recording

Technical info

Name	cMin	bMin	cMax	bMax	vRates	cRates		
A1X	0,000321925	0,00028099	0,138081	0,0615276	1	-2	2 RQ	31.01.2011 16:10:33
A1	0,0140144	0,0146971	0,56111	0,271115	1	-1		
A2								
A3								
A4X	0,00229991	0,0016103	0,0797878	0,0195772	1	-1		
A4	0,0695558	0,0648941	0,236523	0,10109	1	1		
F1X	5,37147e-005	2,68573e-005	0,0131511	0,00906286	1	1	Lie detected	
F1	0,00204782	0,00193537	0,03866	0,0303415	1	-1	Start time	31.01.2011 16:10:33
F2							Video timer (start)	02:35
F3							Stop time	31.01.2011 16:10:41
F4							Video timer (stop)	02:43
F5X	0,243025	0,348067	0,450588	0,424852	1	1	LD time	31.01.2011 16:10:40
F5							LD video timer	02:42
F6								
F7								
F8	0,0460208	0,0525183	0,361447	0,302455	2	2		
F9	0,0338512	0,0431701	0,11822	0,18395	1	-1		
S1	-114,445	-60,7949	112,78	52,7444	2	1		
S2	-5,25213	-6,19922	10,5145	3,17822	1	-1		
S3								
S4	-1	-0,293413	0,547922	0,456464	2	-2		
S5	-0,0521262	-0,0909889	0,316215	0,159266	1	-1		
S6							R(m)	-3
S7	-60,2543	-46,0583	-36,5063	-32,9983	1	0	R(a)	30.3571
P1							tR(i)	171.696
P2	43,6609	46,3716	48,2687	48,4124	1	-1		
P3	0,333964	0,387631	1,11551	0,692358	1	1		
P4								
P5 lie	33,929							
LD	-4							

Vibrimage - video polygraph

Audio mode testing

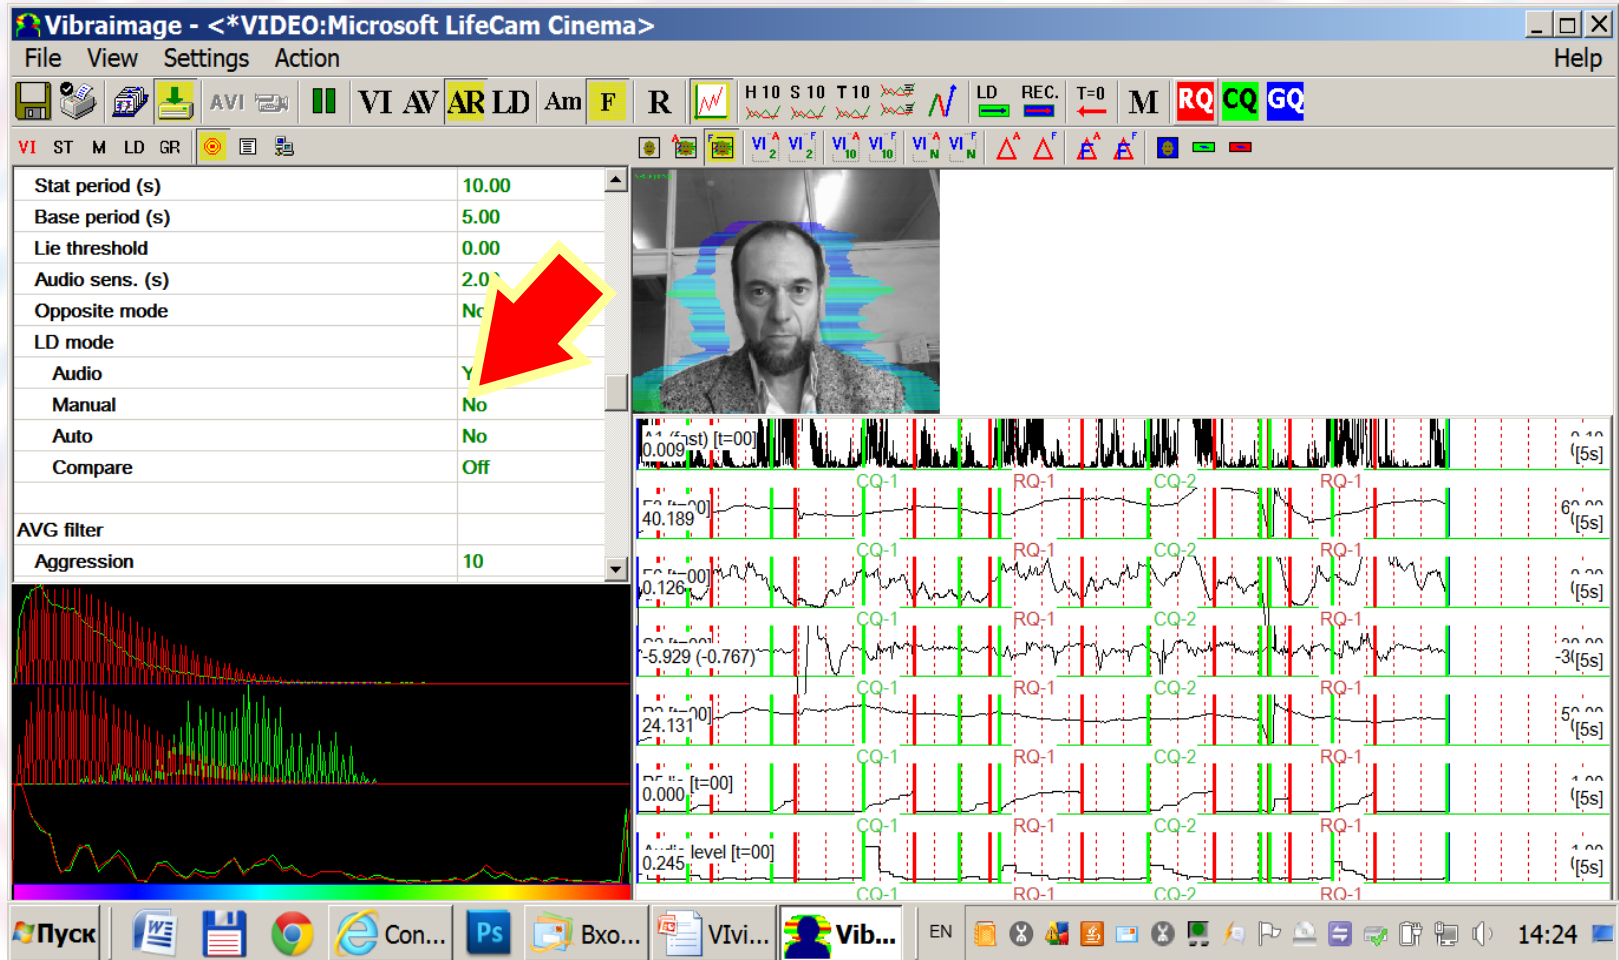

Audio level starts and finishes the stat period processing

Vibrimage - video polygraph

Manual mode testing



Manual regulation of starts and finishes for stat period processing

Vibraimage - video polygraph

Manual mode testing

The screenshot displays the Vibraimage software interface. The title bar reads "Vibraimage - <*VIDEO:Microsoft LifeCam Cinema>". The menu bar includes "File", "View", "Settings", "Action", and "Help". The toolbar contains various icons for file operations, video recording, and analysis. The main window is divided into several sections:


- Settings Panel (Left):** A list of parameters with their current values:
 - Stat period (s): 10.00
 - Base period (s): 5.00
 - Lie threshold: 0.00
 - Audio sens. (s): 2.00
 - Opposite mode: No
 - LD mode: No
 - Audio: No
 - Manual: No
 - Auto: Yes** (highlighted with a red arrow)
 - Compare: Off
- AVG filter:** Aggression: 10
- Video Feeds (Top Right):** Three panels showing a live video feed of a man, a purple-toned face detection overlay, and a red-toned face detection overlay.
- Analysis Graphs (Bottom Right):** A series of six horizontal graphs showing signal processing results. Each graph has a y-axis value and a time interval [t=00] to [t=00]. The graphs are labeled with "CQ-1", "RQ-1", "CQ-2", "RQ-2", "CQ-3", and "RQ-3". The values shown are:
 - 0.034
 - 52.255
 - 0.113
 - 5.611 (-3.343)
 - 22.966
 - 0.321
 - 0.244 level

The Windows taskbar at the bottom shows the system tray with the time 14:39 and various application icons including "Пуск", "To...", "Co...", "Ps", "Bx...", "VI...", and "Vi...".

Auto processing of comparative test or interview

Vibrimage - video polygraph

Manual comparative testing

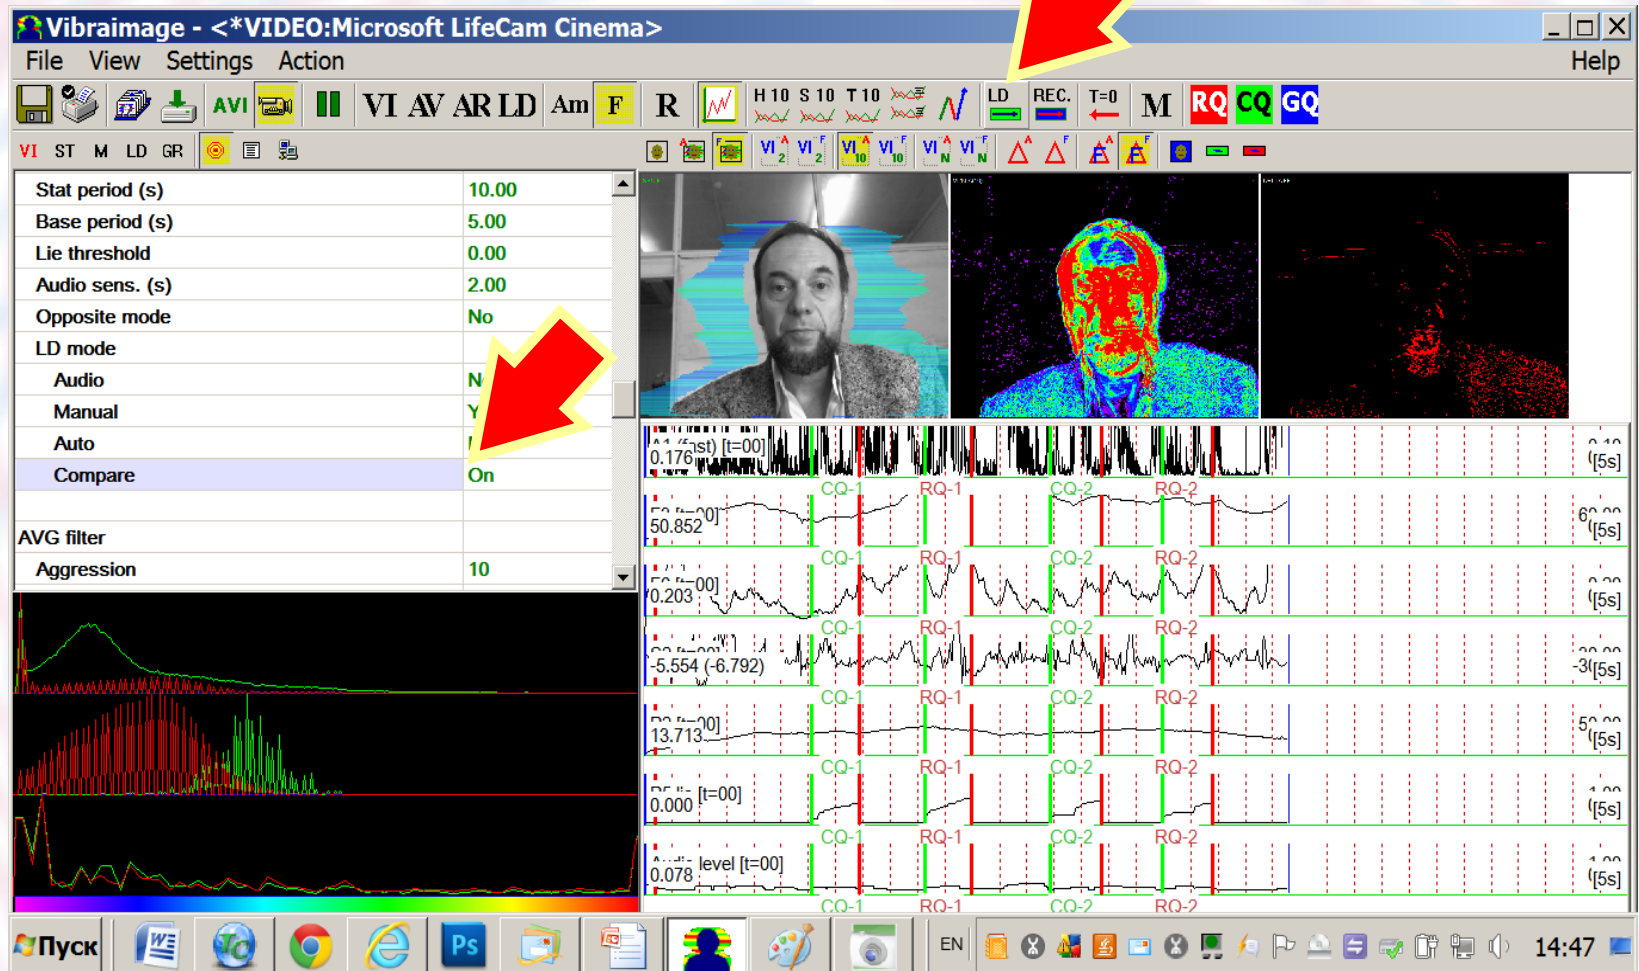

Manual selection of base period for testing and processing

Vibrimage - video polygraph

Contact polygraph vs Vibrimage polygraph. Correlation and problems

Psychophysiological parameters

What is more informative

Vestibulo-emotional reflex + vestibular system

Or

AD. SGR, HR, BW

Normal correlation must be (90-95)%

Problems in correlation

Testing conditions for vibrimaging

Constant and universal light

Experience of personal

More statistics requested

Vibrimage advantages

- **Contactless**
- **Interview**
- **Less time requests**
- **High accuracy and statistics**

Polygraph advantages

- **Long time of experience**
- **Stable results**

Vibralmage store

<http://www.psymaker.com>

Russia

194223, St. Petersburg

Pr. Toreza, 68

Phone/fax: +7 (812) 552 67 19

minkin@elsys.ru

Using of lie-detection
technology

<http://polygraph.pul.ru>

<http://polygraph.tiu.ru>

Russia

460035, Orenburg

Ul. Kommunny, 99

Phone/fax: : +7 (3533) 950133

Phone: +7 903 366 63 07

medvedev241@yandex.ru

medvedev241@mail.ru

CONTACT INFORMATION

Vibrainage - video polygraph

Thank You!

www.elsys.ru

www.psymaker.com

www.vibrabrain.com